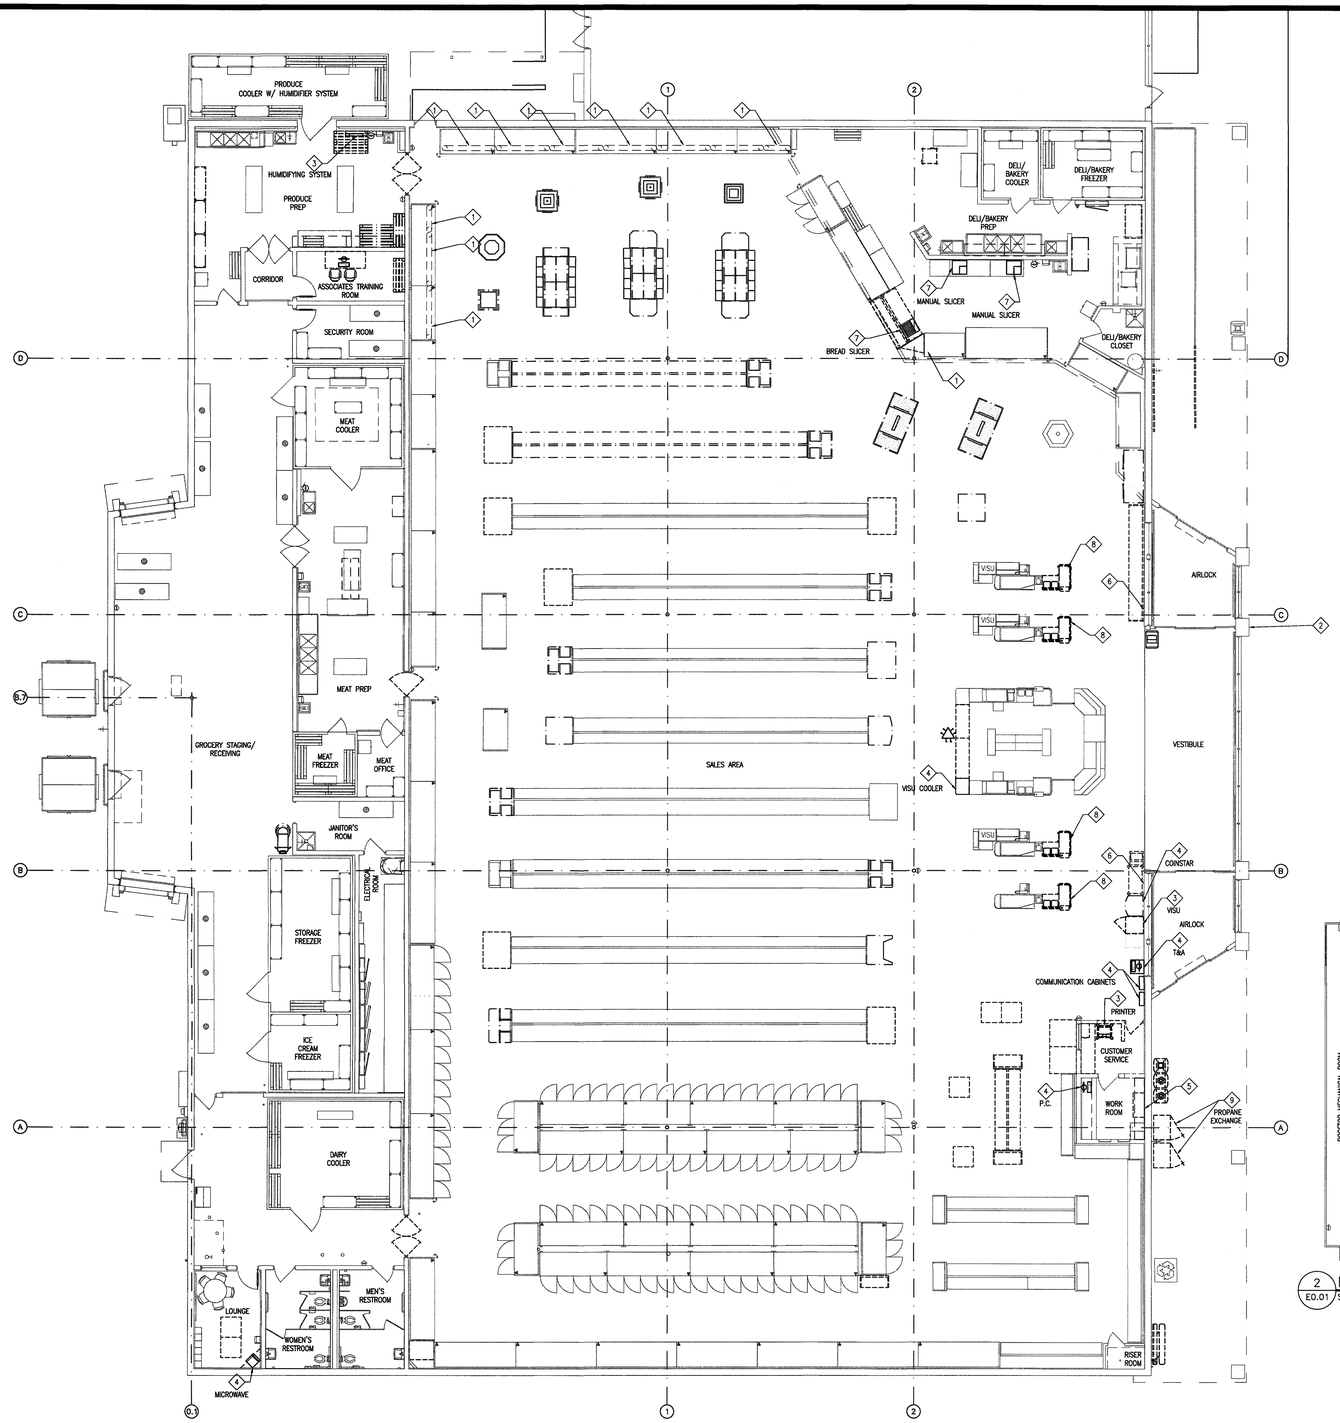

1 ELECTRICAL DEMOLITION PLAN
E0.01 SCALE: 3/32" = 1'-0"

NORTH



2 ELECTRICAL ROOFTOP MECHANICAL ROOM DEMOLITION PLAN
E0.01 SCALE: 3/32" = 1'-0"

NORTH

ELECTRICAL DEMOLITION GENERAL NOTES

1. ALL WIRING SHALL BE DONE IN STRICT ACCORDANCE WITH N.E.C. STANDARDS AND WITH FOOD LION STANDARDS. ALL WORK SHALL BE OF FIRST QUALITY. NO HAZARDOUS WORK WILL BE ACCEPTED. ELECTRICAL CONTRACTOR IS TO MAKE SURE THAT NO MC OR FLEX CABLES ARE USED UNLESS OTHERWISE NOTED. MC OR FLEX CABLES CAN ONLY BE USED IN SHORT RUNS FOR LIGHTING FEEDS. EMT MUST BE USED TO CONNECT PANEL TO JUNCTION BOX AND HAVE COMPRESSION TYPE FITTINGS. SEE SPECIFICATIONS FOR STANDARD PRACTICES.
2. ALL ACCESSIBLE ITEMS OF ELECTRICAL EQUIPMENT CONDUITS, WIRING, LIGHTS, RECEPTACLES, ETC. AFFECTED BY THE RENOVATION WORK AND NOT REQUIRED IN THE COMPLETED WORK SHALL BE CAREFULLY REMOVED. DAMAGED WALLS, FLOORS, CEILINGS, ETC. SHALL BE PATCHED AND FINISHED TO MATCH THE EXISTING ADJACENT SURFACES. REMOVED ITEMS SHALL BE PROPERLY DISPOSED OF OFF SITE AND NOT RE-USED EXCEPT AS NOTED. TURN OVER ALL EXISTING EQUIPMENT DESIRED BY BUILDING OWNER. ITEMS TO BE RE-USED SHALL BE CAREFULLY REMOVED AND STORED IN A PROTECTED AREA BY GC/EC
3. REMOVE UNUSED FEEDER & CONDUIT IN PANELS NOT REQUIRED FOR COMPLETED WORK. UTILIZE EXISTING BREAKERS FOR NEW WORK SHOWN. PROVIDE NEW BREAKERS AS REQUIRED TO SERVE NEW CIRCUITS. LABEL ALL BREAKERS. LABEL ALL BREAKERS NOT USED AS SPARE.
4. ALL LIGHT FIXTURES SHOWN ON DEMOLITION PLAN SHALL BE REMOVED. REFER TO CODED NOTE INDICATED FOR SPECIFIC INSTRUCTIONS.
5. RECONNECT CIRCUITS AS REQUIRED TO MAINTAIN CONTINUITY TO EXISTING DEVICES AND EQUIPMENT NOTED "TO REMAIN" AS WELL AS ADJACENT AREAS WHICH ARE NOT IN CONTRACT.
6. DO NOT DISRUPT THE PULL STATIONS, SAFE, OR ANY COMPONENT OF THE FIRE OR SECURITY SYSTEM WITHOUT FIRST CONTACTING FOOD LION PHYSICAL SECURITY (AARON ASHLEY) AT (704) 633-8250 EXT. 3128.
7. THE ELECTRICAL CONTRACTOR SHALL REVIEW THE HAZARDOUS MATERIAL REPORT, IF APPLICABLE, AND COORDINATE ALL HAZARDOUS MATERIAL REMOVAL WITH THE FOOD LION CONSTRUCTION SUPERVISOR.
8. THE ELECTRICAL CONTRACTOR SHALL PHOTOGRAPH OR VIDEOTAPE EXISTING CONDITIONS IN AND AROUND THE STORE PRIOR TO BEGINNING CONSTRUCTION. PARTICULAR ATTENTION SHOULD BE DIRECTED TO THE CEILING, ALL LIGHTING AND PANELS.
9. THE ELECTRICAL CONTRACTOR SHALL COORDINATE REMOVAL/RELOCATION OF LOTTERY EQUIPMENT WITH THE GENERAL CONTRACTOR AND THE FOOD LION CONSTRUCTION SUPERVISOR. ALL MEDIA SHALL BE MADE AVAILABLE TO FOODLION UPON REQUEST.
10. ANY WORK IN REST ROOMS TO BE SCHEDULED TO ALLOW FOR AT LEAST ONE TO REMAIN OPEN AT ALL TIMES. COORDINATE WITH FOOD LION CONSTRUCTION SUPERVISOR. PROPER SIGNAGE MUST BE INSTALLED WITH UNISEX RESTROOMS, USE SLIDE LOCK. PROVIDED BY FOOD LION.
11. THE GENERAL CONTRACTOR SHALL COORDINATE THE REMOVAL, RELOCATION AND RETENTION OF THE EXISTING SALES AREA LIGHTING WITH THE ELECTRICAL CONTRACTOR. THE ELECTRICAL CONTRACTOR SHALL REMOVE ANY SPOTLIGHTS FROM THE SALES AREA UNLESS NOTED TO REMAIN. REFER TO SHEET E1.01 FOR ADDITIONAL INFORMATION.
12. ANY LIGHT FIXTURES TO BE REUSED ARE TO BE REMOVED AND STORED IN A MANNER THAT RENDERS THEM REUSABLE IN A SECURED TRAILER BY THE GENERAL CONTRACTOR.
13. ELECTRICAL CONTRACTOR TO REMOVE CEILING MOUNTED RECEPTACLES.

ELECTRICAL DEMOLITION KEY NOTES

1. LIGHT FIXTURE(S) TO BE REMOVED. DISCONNECT FIXTURE, REMOVE FEEDER AND CONDUIT BACK TO NEXT EXISTING TO REMAIN LIGHT FIXTURE.
2. STOREFRONT SIGN TO BE REPLACED. FEEDER & CONDUIT TO REMAIN FOR RECONNECTION. REMOVE EXCESS JUNCTION BOXES. REFER TO E1.01 FOR ADDITIONAL INFORMATION.
3. EQUIPMENT TO BE REMOVED. REMOVE DEVICES, AND REROUTE FEEDER AND CONDUIT BACK TO SOURCE. LABEL BREAKERS AS "SPARE" FOR NON-REUSED CIRCUITS. PATCH, REPAIR AND SEAL PENETRATIONS AS REQUIRED FROM NEW WORK.
4. EQUIPMENT TO BE RELOCATED. ELECTRICAL CONTRACTOR SHALL DISCONNECT AS REQUIRED, REMOVE DEVICES, WIRE, CONDUITS AND REROUTE FEEDER AND CONDUIT TO NEW LOCATION. REFER TO E1.02 FOR ADDITIONAL INFORMATION.
5. RECEPTACLES, COMMUNICATIONS, DATA, AND JUNCTION BOXES BELOW 48" AFF TO BE RELOCATED TO 48" AFF BEHIND NEW CABINET TO BE INSTALLED IN WORK ROOM.
6. CONDUITS ON THIS WALL TO BE RECESSED BEHIND GYPSUM WALL BOARD OR REMOVED IF NOT REUSED.
7. DELI/BAKERY EQUIPMENT TO BE RELOCATED. REMOVE DEVICES AND REMOVE FEEDER AND CONDUIT BACK TO J-BOX. REFER TO E4.01 FOR ADDITIONAL INFORMATION.
8. ELECTRICAL CONTRACTOR SHALL DISCONNECT CHECK STAND PARTIALLY, FOOD LION ELECTRICAL CONTRACTOR SHALL REMOVE AND DISPOSE OF CHECK STANDS. PRESERVE FEEDER AND CONDUIT FOR REUSE.
9. PROPANE EXCHANGE TO BE REMOVED, ELECTRICAL CONTRACTOR SHALL FIELD VERIFY THAT ALL ELECTRICAL CONNECTIONS ARE CAPPED OFF WITHIN 5' OF THE FINAL LOCATION OF THE NEW PROPANE EXCHANGES. ELECTRICAL CONTRACTOR SHALL REMOVE ALL WIRING AND CAP OFF CONDUITS.

ATM NOTE:
ELECTRICAL CONTRACTOR SHALL NOT UNPLUG ATM FOR ANY REASON. NO ONE IS ALLOWED TO USE THE ELECTRICAL OUTLET OR PHONE LINE JACK FOR ANY REASON. IT IS ILLEGAL TO ATTACH ANY DEVICE TO THE ATM LINE FOR ANY REASON. THE ONLY PEOPLE ALLOWED TO UNPLUG THE ATM ARE NATIONWIDE SERVICE AND THE COMPANY THAT REPLENISHES CASH IN THE ATM. COORDINATE ANY AND ALL WORK ASSOCIATED WITH THE ATM WITH FOOD LION CONSTRUCTION SUPERVISOR AND NATIONWIDE SERVICE AND/OR THE COMPANY THAT REPLENISHES CASH.

LEGEND
= = = = = = = = ITEMS TO BE REMOVED AS NOTED ON PLAN
— · — · — · — ITEMS TO BE RELOCATED

INTERPLAN LLC
ARCHITECTURE
ENGINEERING
INTERIOR DESIGN
PROJECT MANAGEMENT

604 COURTLAND STREET
SUITE 100
ORLANDO, FLORIDA 32804
PH 407.645.5008
FX 407.629.9124

ARCHITECT'S SEAL:

PROFESSIONAL CERTIFICATION: I HEREBY CERTIFY THAT THESE DOCUMENTS WERE PREPARED OR APPROVED BY ME, AND THAT I AM A DULY LICENSED ENGINEER UNDER THE LAWS OF THE STATE OF MARYLAND
LICENSE NO: 05-51160
EXPIRATION DATE: 6/21/2021

ENGINEER'S SEAL:

STATE OF MARYLAND · BRIAN K. HERSON · 51160 · PROFESSIONAL ENGINEER

JAN 29 2020

REVISIONS
NO DATE REMARKS

FOOD LION
2110 Executive Drive, Salisbury, NC 28145
telephone: 704.633.8250
foodlion.com
Food Lion is a DELHAIZE AMERICA company.

FOOD LION REMODEL STORE #1662

410 SANDY SPRING RD
LAUREL, MD 20707

PROJECT NO: 2019.0893
DATE: 1-30-20

E0.01
ELECTRICAL DEMOLITION PLAN

CHECKED: BKJ DRAWN: MW

COPYRIGHT © 2020 INTERPLAN LLC. RESERVES COPYRIGHT & OTHER RIGHTS RESTRICTING THESE DOCUMENTS TO THE ORIGINAL SITE OR PURPOSE FOR WHICH THEY WERE PREPARED. REPRODUCTIONS, CHANGES OR ASSIGNMENTS ARE PROHIBITED.

CORBIR - 01/29/2020 4:47:52 AM